



Outputs A and Outputs B are different contact of DPDT relays. Each port can be used **differently** to supply internal 12V (not recommended), any external voltage, or GND.

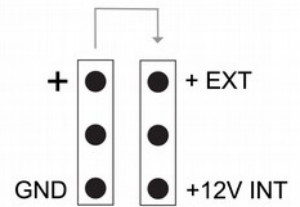

If you select GND the jumper EXT/INT jumper position doesn't matter.

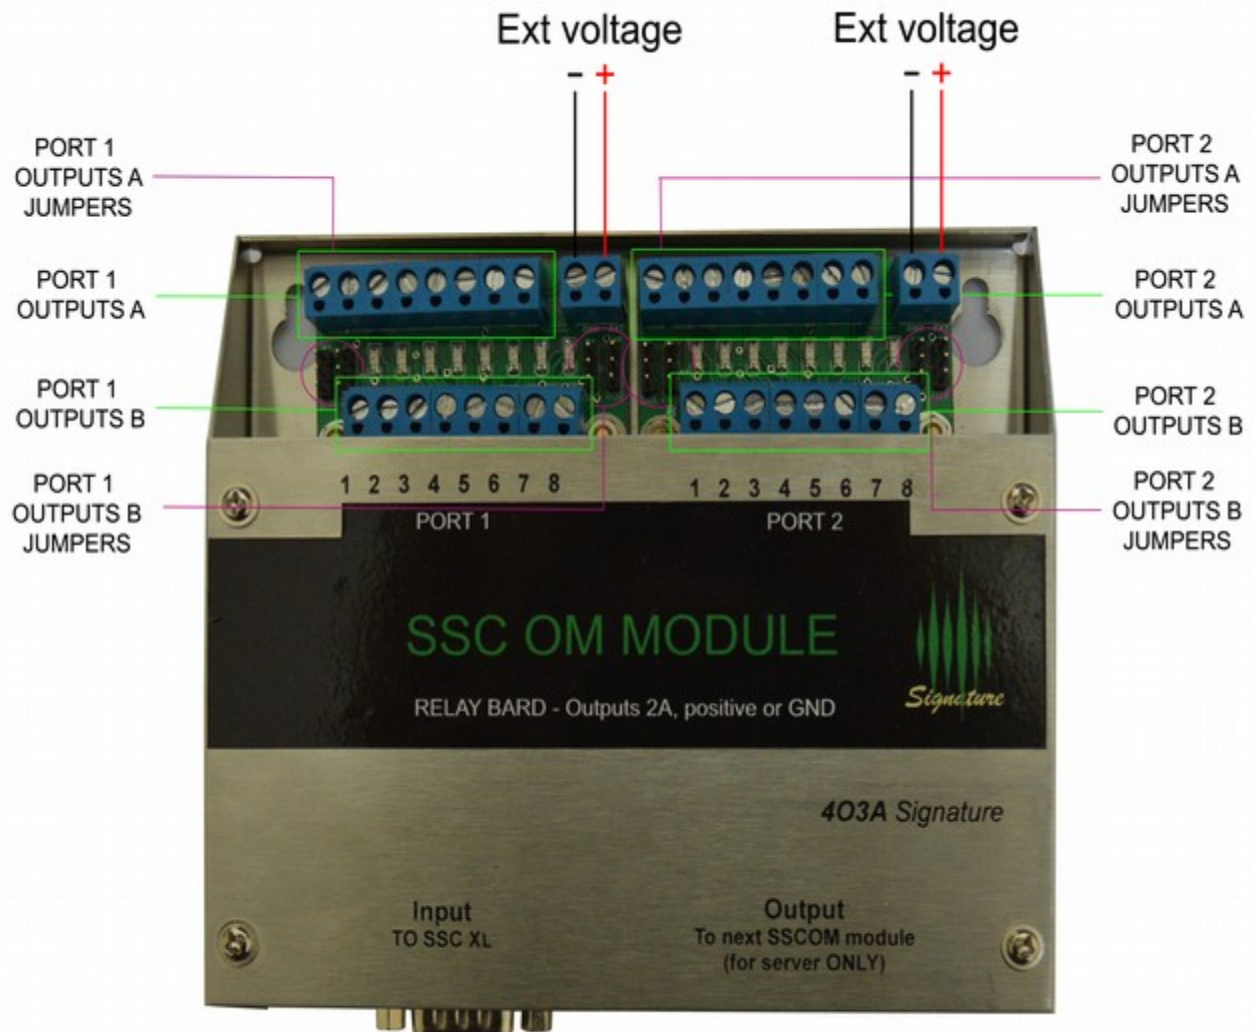

Internal voltage is used for testing and programming, and it is strongly recommended to use proper external power supply and set jumpers to EXT. Internal power supply in SSC XL is 1A, which is on the margin if all relays are in use.